


F.H.W.A. REGION	STATE	PROJECT NO.	SHEET NO.	TOTAL SHEETS	RECORD DRAWING
9	ARIZ.				

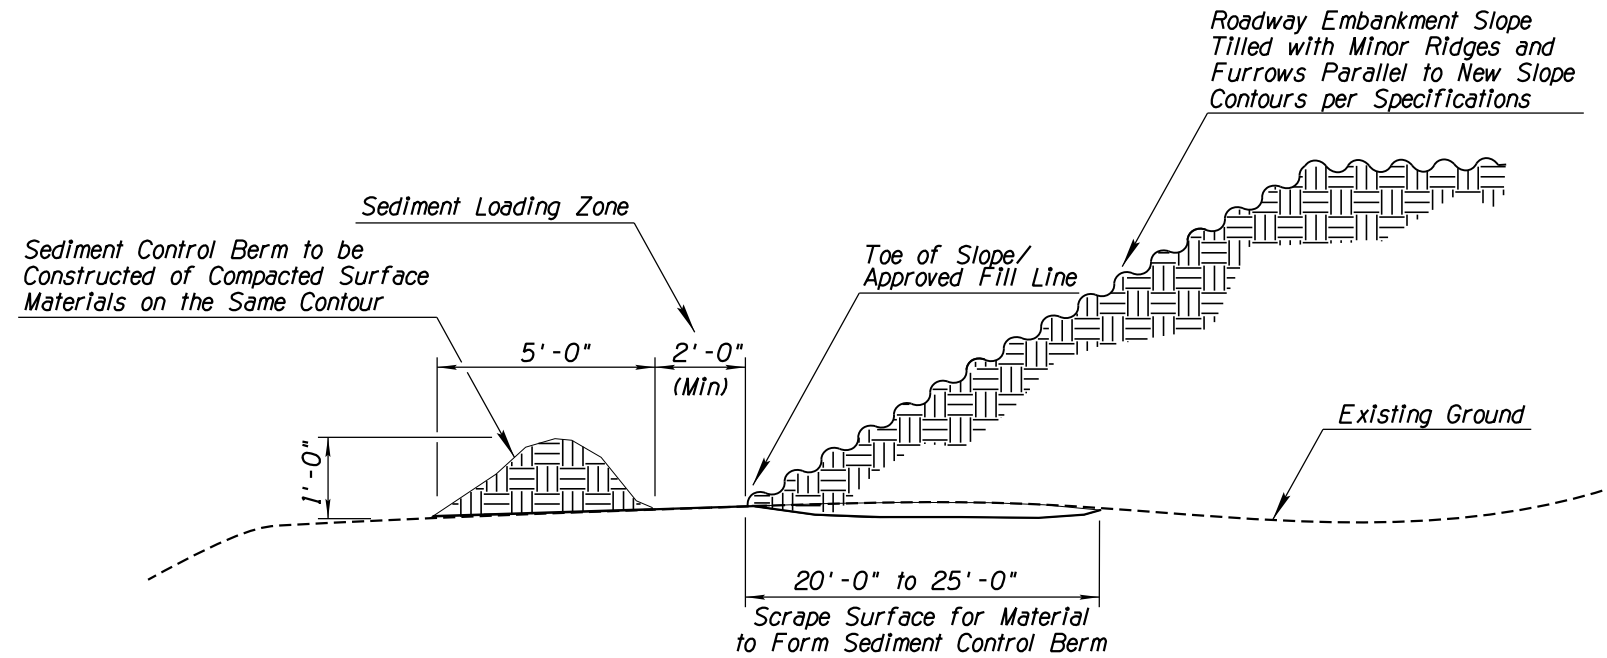

SEDIMENT CONTROL BERM SECTION (NTS)

NOTES:

1. Locate Sediment Control Berms as indicated on plans or as directed by the Engineer.
2. Surface materials i.e. soil, rock, branches, leaves, slash and chips shall be scraped from the existing grade as needed to construct the berm prior to placement of roadway embankment. After scraping material into berm, compact berm as shown. Rock and slash shall extend no more than 4" above the surface.
3. Construct Sediment Control Berm on the same contour as the toe of new slope and a minimum of 2'-0" beyond the toe of new slope. For the seeded areas, till to form minor ridges and furrows parallel to new slope contours and as specified in Section 805 of the Standard Specifications and these special provisions.
4. The installation and maintenance of Sediment Control Berm BMPs shall not negatively impact traffic safety, nor the designed function of roadway or bridge drainage facilities. For erosion/sediment control purposes, Sediment Control Berm BMPs shall be installed and maintained to carry the stormwater of at least 2-year, 24-hour events.
5. Remove Sediment Control Berms per the direction of the Engineer or as soon as practicable upon stabilization of the construction disturbed area.
6. Make field adjustments and corrections of Sediment Control Berm BMP immediately if it is causing flooding, erosion, and/or affecting roadway safety.
7. Sediment Control Berms may be paid as a part of slope construction/roadway excavation. When paid separately, the Sediment Control Berm BMP's pay/bid item shall include all materials used for this BMP: all ground preparation, furnishing, installing, final removal, and disposal of this temporary BMP, as well as returning the area to an acceptable condition as approved by the Engineer.
8. OPTION TO SEDIMENT CONTROL BERM: When shown on layout plans and/or called for in Special Provisions, for urban situations, or where surface materials are not available, use wattles. Wattles shall be selected, installed, and maintained in accordance with manufacturers' specifications and good engineering practices. Refer to Sediment Wattle BMP detail.
9. Make field adjustments and corrections to ensure NO sensitive biological resources (native species / habitats) will be adversely impacted.

# DETAIL ES6

SEDIMENT CONTROL BERM

DESIGN	NAME	DATE	ARIZONA DEPARTMENT OF TRANSPORTATION INFRASTRUCTURE DELIVERY AND OPERATIONS DIVISION <b>ROADSIDE DEVELOPMENT SECTION</b>  STORMWATER QUALITY PROTECTION & EROSION/SEDIMENT CONTROL DETAILS
DESIGN	TAO ZI FONG	7-2016	
DRAWN	HAN MENG	7-2016	
DRAWN	TAO ZI FONG	7-2016	
DRAWN	HAN MENG	7-2016	
CHECKED	JOHN R. HUCKO	7-2016	
TEAM LEADER	E LEROY BRADY	7-2016	
ROUTE	MP	LOCATION	
TRACS NO.			SHEET OF
			OF

NO. 1 DESCRIPTION OF REVISION  
MADE BY  
DATE  
NO. 2 DESCRIPTION OF REVISION  
MADE BY  
DATE